


BOROUGH OF FOX CHAPEL SANITARY SEWER LATERALS

THE FOLLOWING SUMMARIZES THE INSTALLATION REQUIREMENTS FOR SANITARY SEWER LATERALS IN FOX CHAPEL BOROUGH. FOR FURTHER INFORMATION, REFER TO THE "RULES AND REGULATIONS GOVERNING HOUSE OR BUILDING SANITARY SEWER CONNECTIONS."

AFTER THE 4" TRAP...

ALL PIPE SHALL BE 6" SDR 35 AND BEDDED IN 6" OF 1B RIVER GRAVEL.
 ALL CLEANOUTS SHALL BE 6" STRAIGHT TEES OR SANITARY TEES ON THEIR BACK WITH 6" DIAMETER PIPE EXTENDING TO OR ABOVE GRADE. WYES MAY NOT BE USED IN CLEANOUTS OR SIGHT TEES.
 ALL CLEANOUTS & INSPECTION TEES SHALL HAVE AN SDR 35 PVC FEMALE ADAPTER (P1404) WITH A THREADED CAP (P1146). WHEN SUCH CLEANOUTS OR INSPECTION TEES ARE IN AN IMPERVIOUS SURFACE, A JOSUM 56046-88 CAST IRON COVER IS ALSO REQUIRED.
 AREA AROUND PIPE TO A HEIGHT OF 12" ABOVE THE PIPE SHALL BE BACKFILLED WITH 1B RIVER GRAVEL.

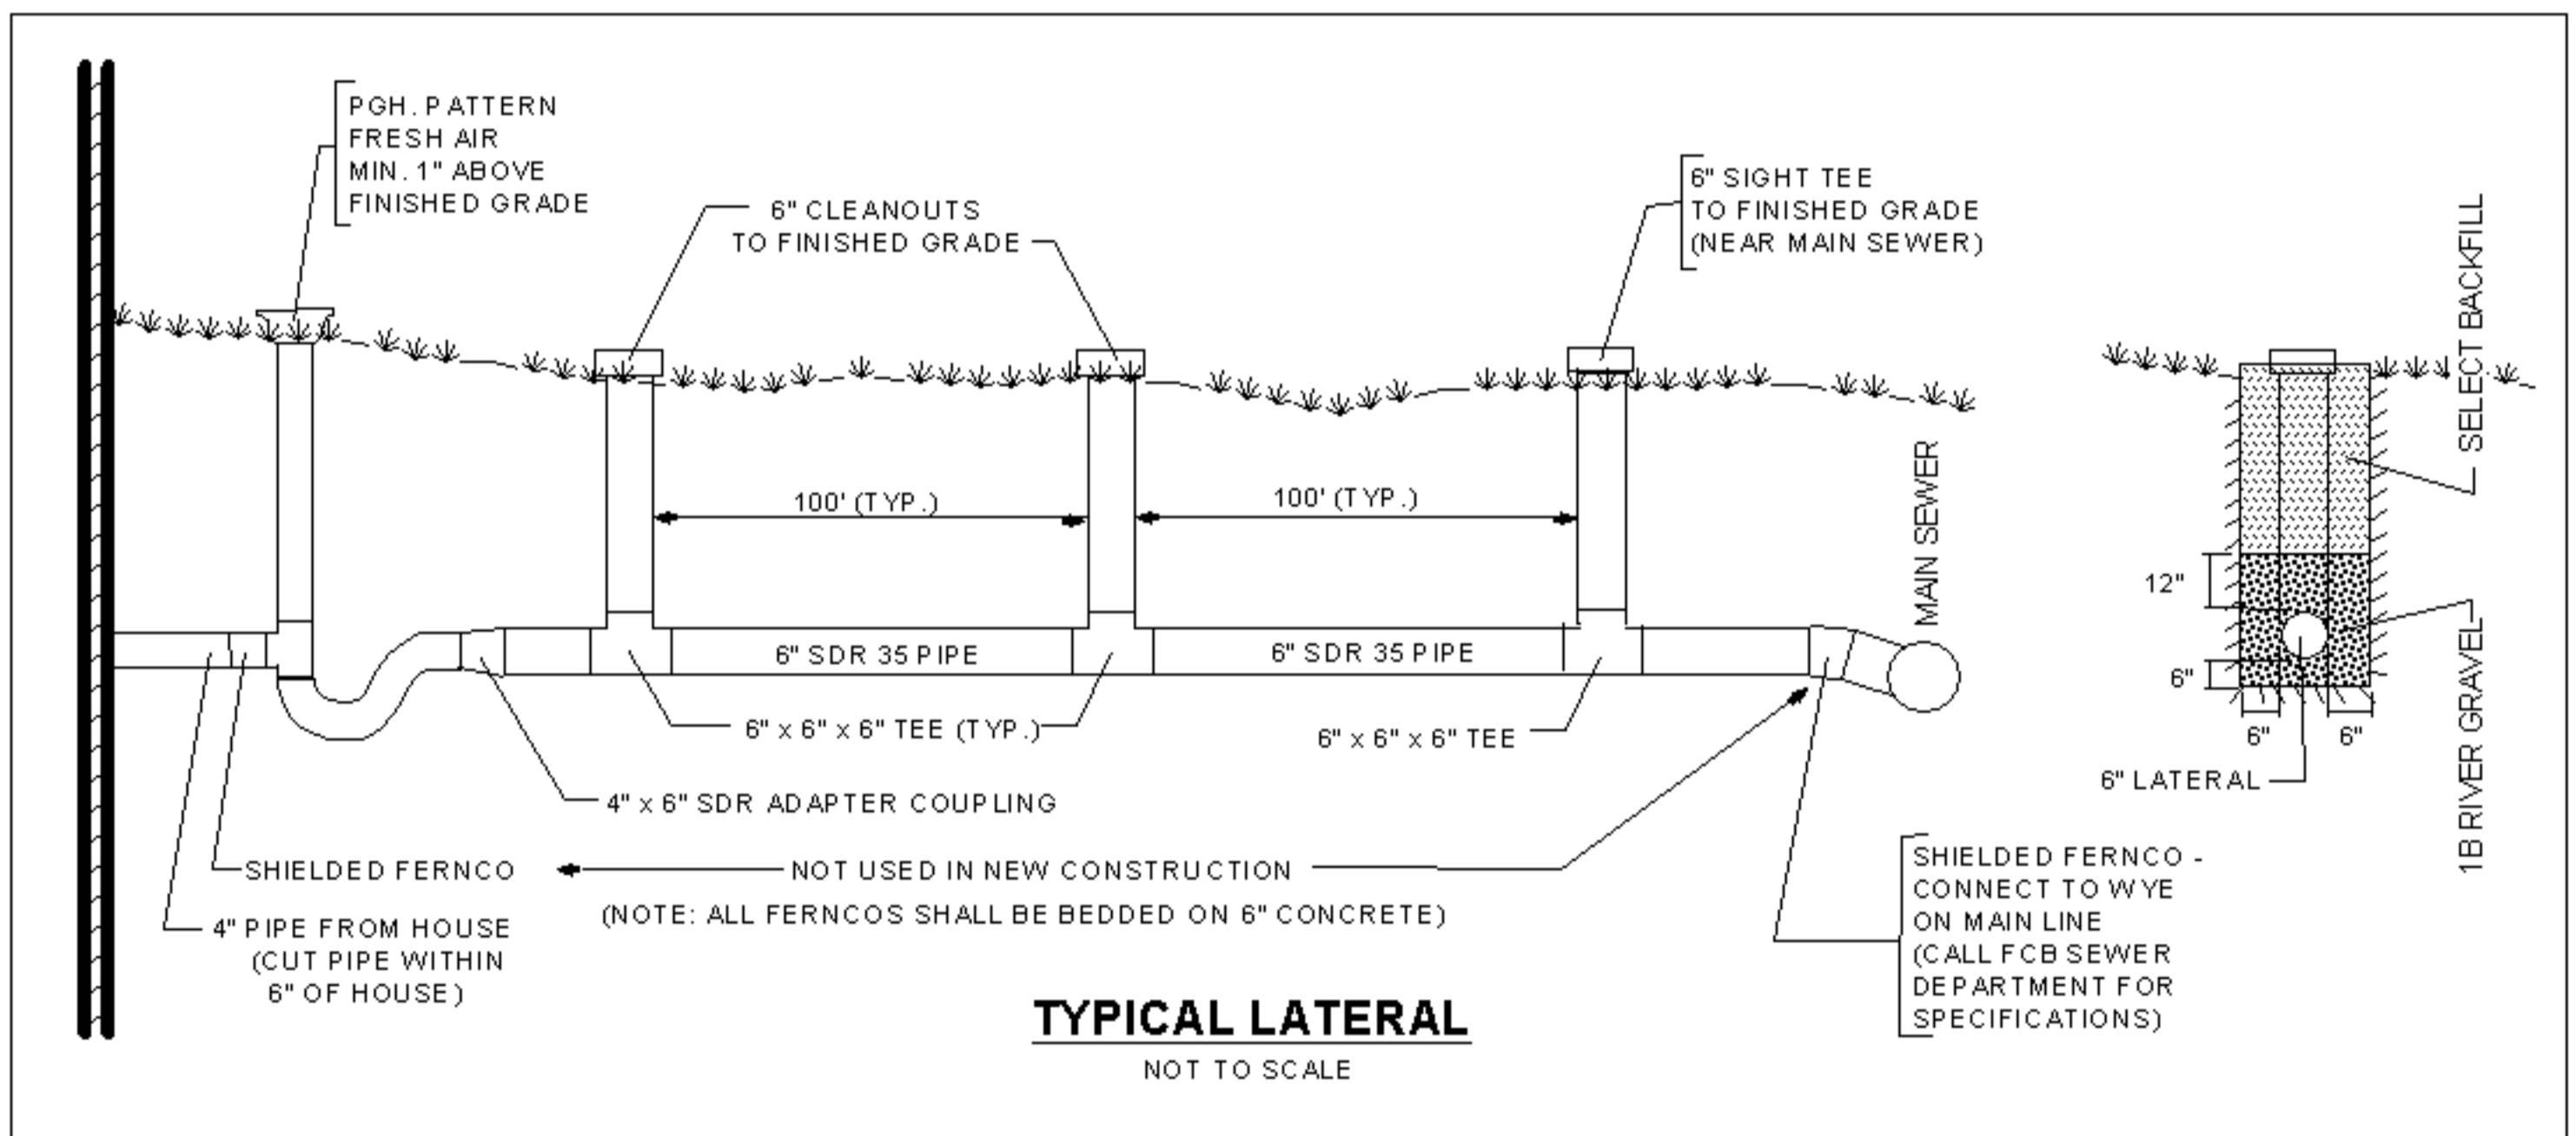

REQUIRED INSPECTION BY BOROUGH...

1. ALL REPAIRS.
2. AFTER ALL PIPE AND CLEANOUTS HAVE BEEN BEDDED AND INSTALLED BUT BEFORE PIPE IS COVERED.
3. LEAK TESTING MUST BE WITNESSED BY THE BOROUGH.
4. 12" GRAVEL IN PLACE PRIOR TO BACKFILLING WITH SELECT MATERIAL.

NOTE: Any contractor who is not fully ready for the inspection at the scheduled time will be subject to a reinspection fee of \$25.

PLUMBERS MUST CALL BY 9:00 AM TO SCHEDULE INSPECTIONS

NO INSPECTIONS WILL BE MADE AFTER 2:30 PM